

HEALTH DEPARTMENT DISTRICT JIND



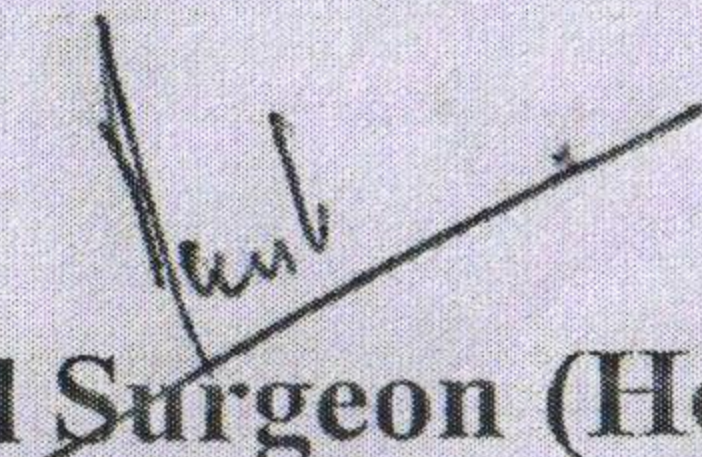
Hygienic Certificate

Certified that Dy. Civil Surgeon (Health) O/o Civil Surgeon Jind verified the report of SMO CHC JULANA (Jind) who inspected the premises of MRCR PUBLIC SCHOOL HANSI ROAD JULANA Jind. on 02-05-2026 and found the hygienic and sanitation condition of premises satisfactory for the year 2026-27.

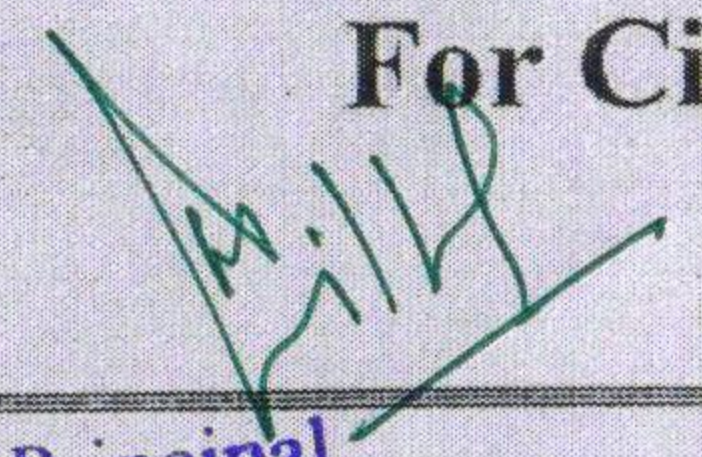
Memo No. Hygienic/CSJind/2026-27/14

Dated : 11/5/2026


Manager,
MRCR Public School
JULANA


Dy. Civil Surgeon (Health)
For Civil Surgeon Jind.

11/5/2026


Principal,
MRCR Public School
Hansi Road, Julana (Jind)

Govt. of Haryana
Public Health Engineering Department, Water Testing Laboratory, Jind
 Email id: chemist.jnd@gmail.com Ph.No.01681-246354



Test Report

Memo No:- : 390 Date:- 13.04.2026
 Job Order No:- : PC29/4/2026
 Test Report No:- : JND/00116/4/2026
 Issued To:- : MRCR PUBLIC SCHOOL,
 JULANA
 Customer Reference No:- : 706 Dated:-07.04.2026
 Sample Description : Drinking Water
 Sample Type : Chemical Analysis
 Sample collected on dated : 07.04.2026
 Sample Collected by : Party Self
 Sample received on dated : 07.04.2026
 Sample Location : MRCR PUBLIC SCHOOL JULANA
 Sample Quantity : 2ltr
 Date of Analysis started : 07.04.2026
 Dated of analysis completed : 10.04.2026
 Issue Date : 13.04.2026

Environmental Conditions:-Temperature (°c) =24.8 & Humidity (%) =65

RESULTS

Sr. No.	Parameter	Protocol Used	Results	IS: 10500: 2012 (RA-2023)		Unit
				Desirable limit	Max. Permissible limit (in absence better alternate source)	
1.	Taste	IS 3025(Part8): 2023	Agreeable	Agreeable		-----
2.	Odour	IS 3025(Part5): 2018	Agreeable	Agreeable		-----
3.	Colour	APHA 24 th edition-2120-B	5.0	5	15	Hazen Unit
4.	Turbidity	APHA 24 th edition -2130 B	0.39	1	5	NTU
5.	Total Dissolved Solids@180°c±2°c	APHA 24 th edition -2540 C	253	500	2000	mg/L
6.	Total Hardness	APHA 24 th edition -2340 C	92	200	600	mg/L
7.	Calcium (as Ca)	APHA 24 th edition -3500-Ca B	11.22	75	200	mg/L
8.	Magnesium (as Mg)	APHA 24 th edition -3500 Mg B	15.55	30	100	mg/L
9.	Total Alkalinity	APHA 24 th edition - 2320 B	68	200	600	mg/L
10.	Chloride (as Cl)	APHA 24 th edition -4500 Cl B	40.99	250	1000	mg/L
11.	Fluoride (as F)	APHA 24 th edition -4500- F C	0.24	1.0	1.5	mg/L
12.	Sulphate (as So ₄)	APHA 24 th edition -4500-So ₄ E	35	200	400	mg/L
13.	Nitrate (as NO ₃)	APHA 24 th edition -4500-No ₃ D	<0.5	45	45	mg/L
14.	Iron (as Fe)	APHA24 th edition-3500-Fe B	0.02	1.0	1.0	mg/L
15.	pH @25°c	APHA 24 th edition -4500-H ⁺ B	7.42	6.5 to 8.5	No relaxation	-----

Notes:

- The results given above are related to the sample as received and tested in PHED Lab, Jind. Reliability of sample lies with the sender.
- Sample not collected by this Laboratory.
- The test report can't be regenerated/re-produced in whole or in part without written permission of Laboratory.
- The test report can't be used for any publicity or any legal purpose.
- The test samples meant for chemical analysis will be disposed off after 7 days from the date of issue of test report unless until specifically requested by the customer for retaining over a longer period.

Sample analyzed by: Sumit

Principal,
MRCR Public School
 Hansi Road, Julana (Jind)

(Signature)
MRCR Public School,
JULANA

Reviewed & Approved by

(Signature)
 (Virender Singh)
 Authorized Signatory/Chemist
 PHED Water Testing Laboratory, Jind

END OF TEST REPORT